

# LEGEND

- FP** MANUAL PULL STATION
- SP** STANDPIPE HOSE OUTLET
- WS** FIRE WARDEN STATION
- FC** FIRE COMMAND STATION
- FD** FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- SCV** STANDPIPE CONTROL VALVE
- SPV** SPRINKLER CONTROL VALVE
- DWMCV** DOMESTIC WATER MAIN CONTROL VALVE
- ER** EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- 1-HR FIRE BARRIER
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE	NAME	ISSUED/ COMMENTS
1	03.21.21	JG	REVISED PER ANNUAL SURVEY ISSUED FOR REVIEW AND FILING

Drawn By: JHR      Checked By: EX

BUILDING ADDRESS:  
**16 East 52nd Street**  
 New York, N.Y. 10022

DRAWING TITLE:  
**FL-15**  
 15TH FLOOR


SURVEY BY: JW      SURVEY DATE: 03.20.21

FIRE TOWER  
STAIR WELL **C**

STAIR WELL **B**

ELEV BANK **A**

FULL SPRINKLER COVERAGE

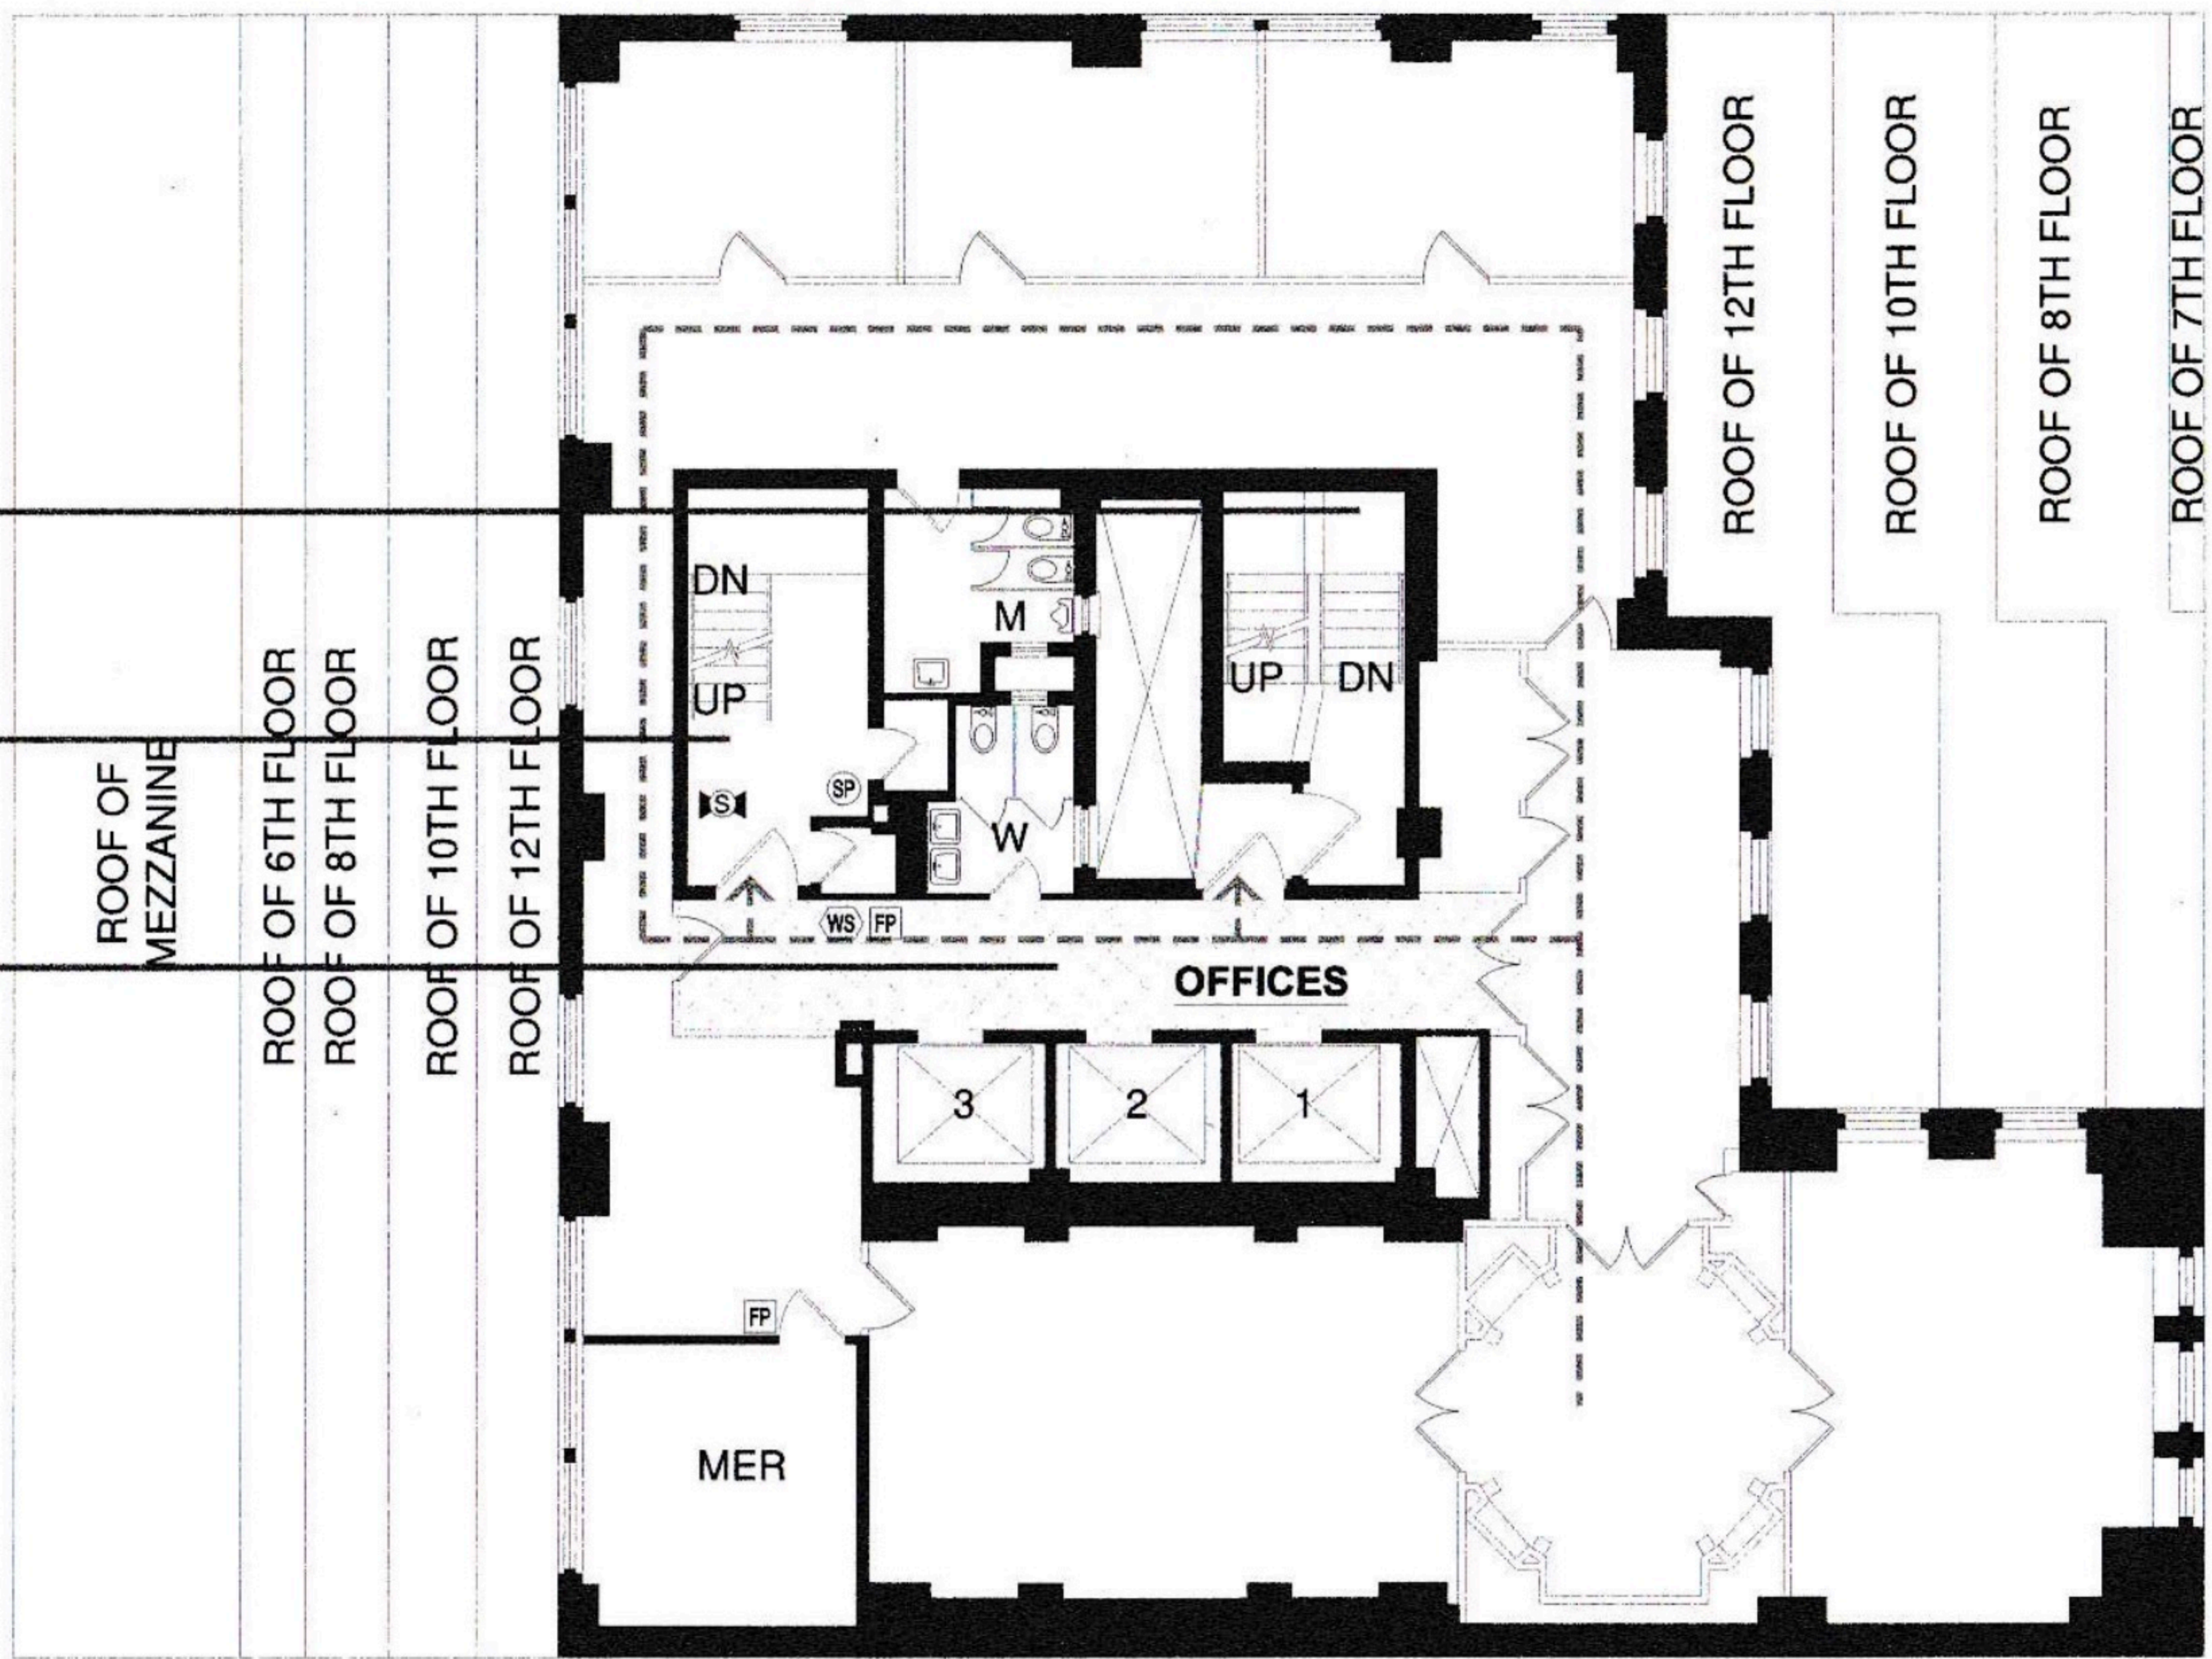

EAST 52ND STREET