


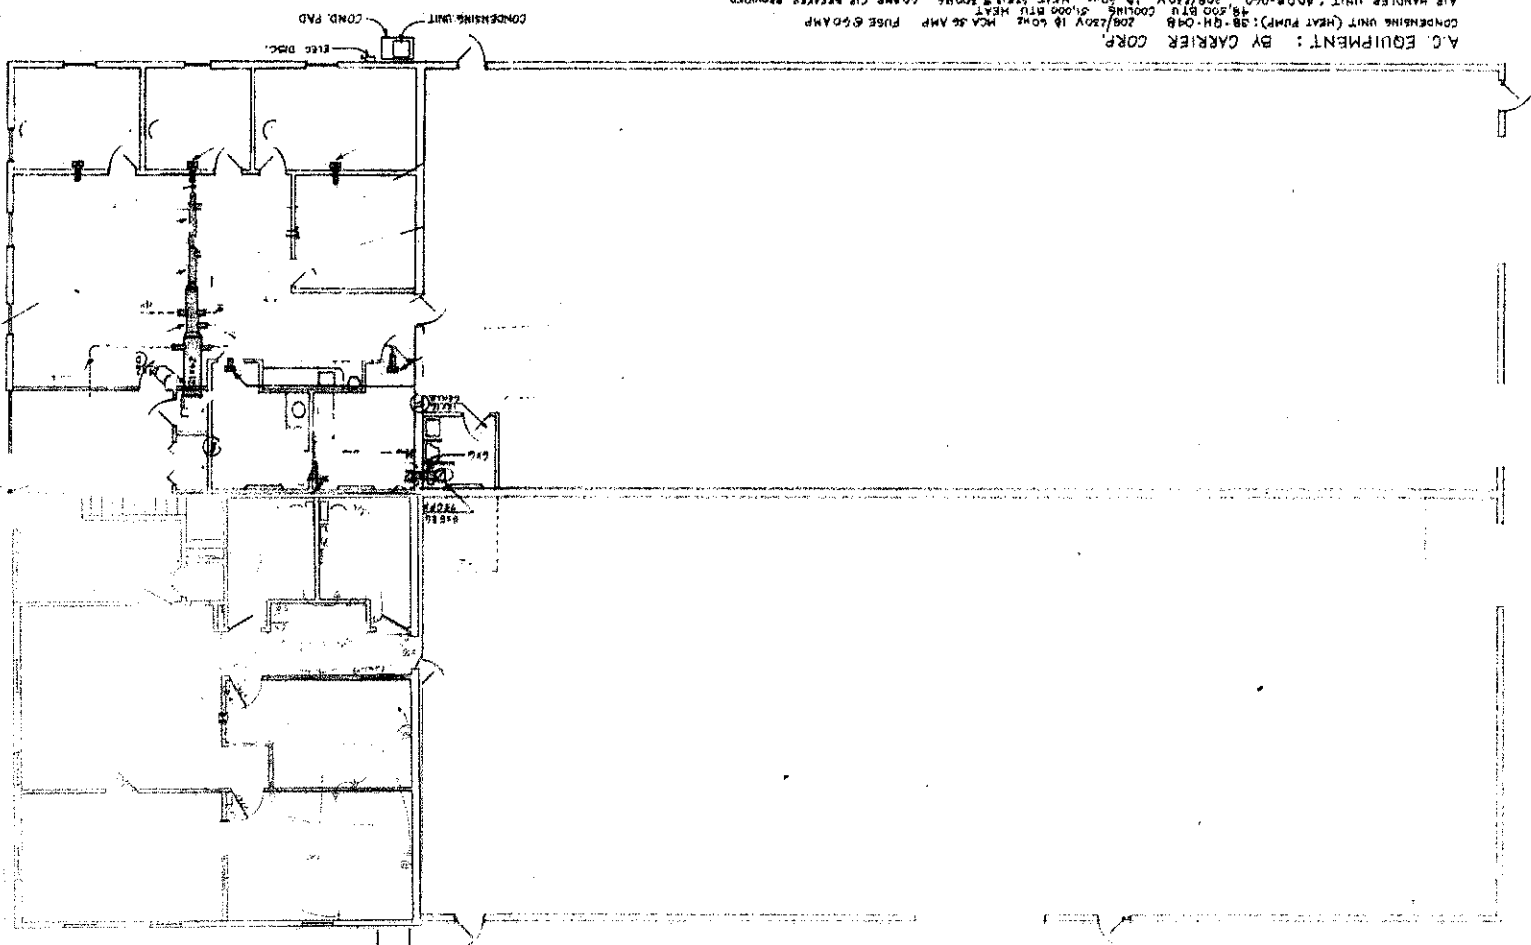

A/C EQUIPMENT: BY CARRIER CORP.
CONDENSING UNIT (HEAT PUMP) : 98-QY-04-B
AIR HANDLER UNIT : 4000-060
CONTROLS : CARRIER FSTAT # 7000
E-FI : LOZEN COOK * ACSE-D-90C-10D 91WATS BALANCE TO 336 CFM

A/C EQUIPMENT: BY CARRIER CORP.
CONDENSING UNIT (HEAT PUMP) : 98-QY-04-B
AIR HANDLER UNIT : 4000-060
CONTROLS : CARRIER FSTAT # 7000
E-FI : LOZEN COOK * ACSE-D-90C-10D 91WATS BALANCE TO 336 CFM

[illegible]

DUCT INSTALLATION:
FLEXIBLE ROUND DUCT "DROP-IN" USE CLOSURE SYSTEMS[®] W/TYPE FLX
MAYNILE MICRO-AIR[®] RIGID FIBERGLASS TRUNK & PLENUMS W/TYPE FLX
INSTALL AS PER MAYNILE FABRICATION MANUAL & LATEST B.M.C.M.A. STANDARDS

[illegible][illegible]