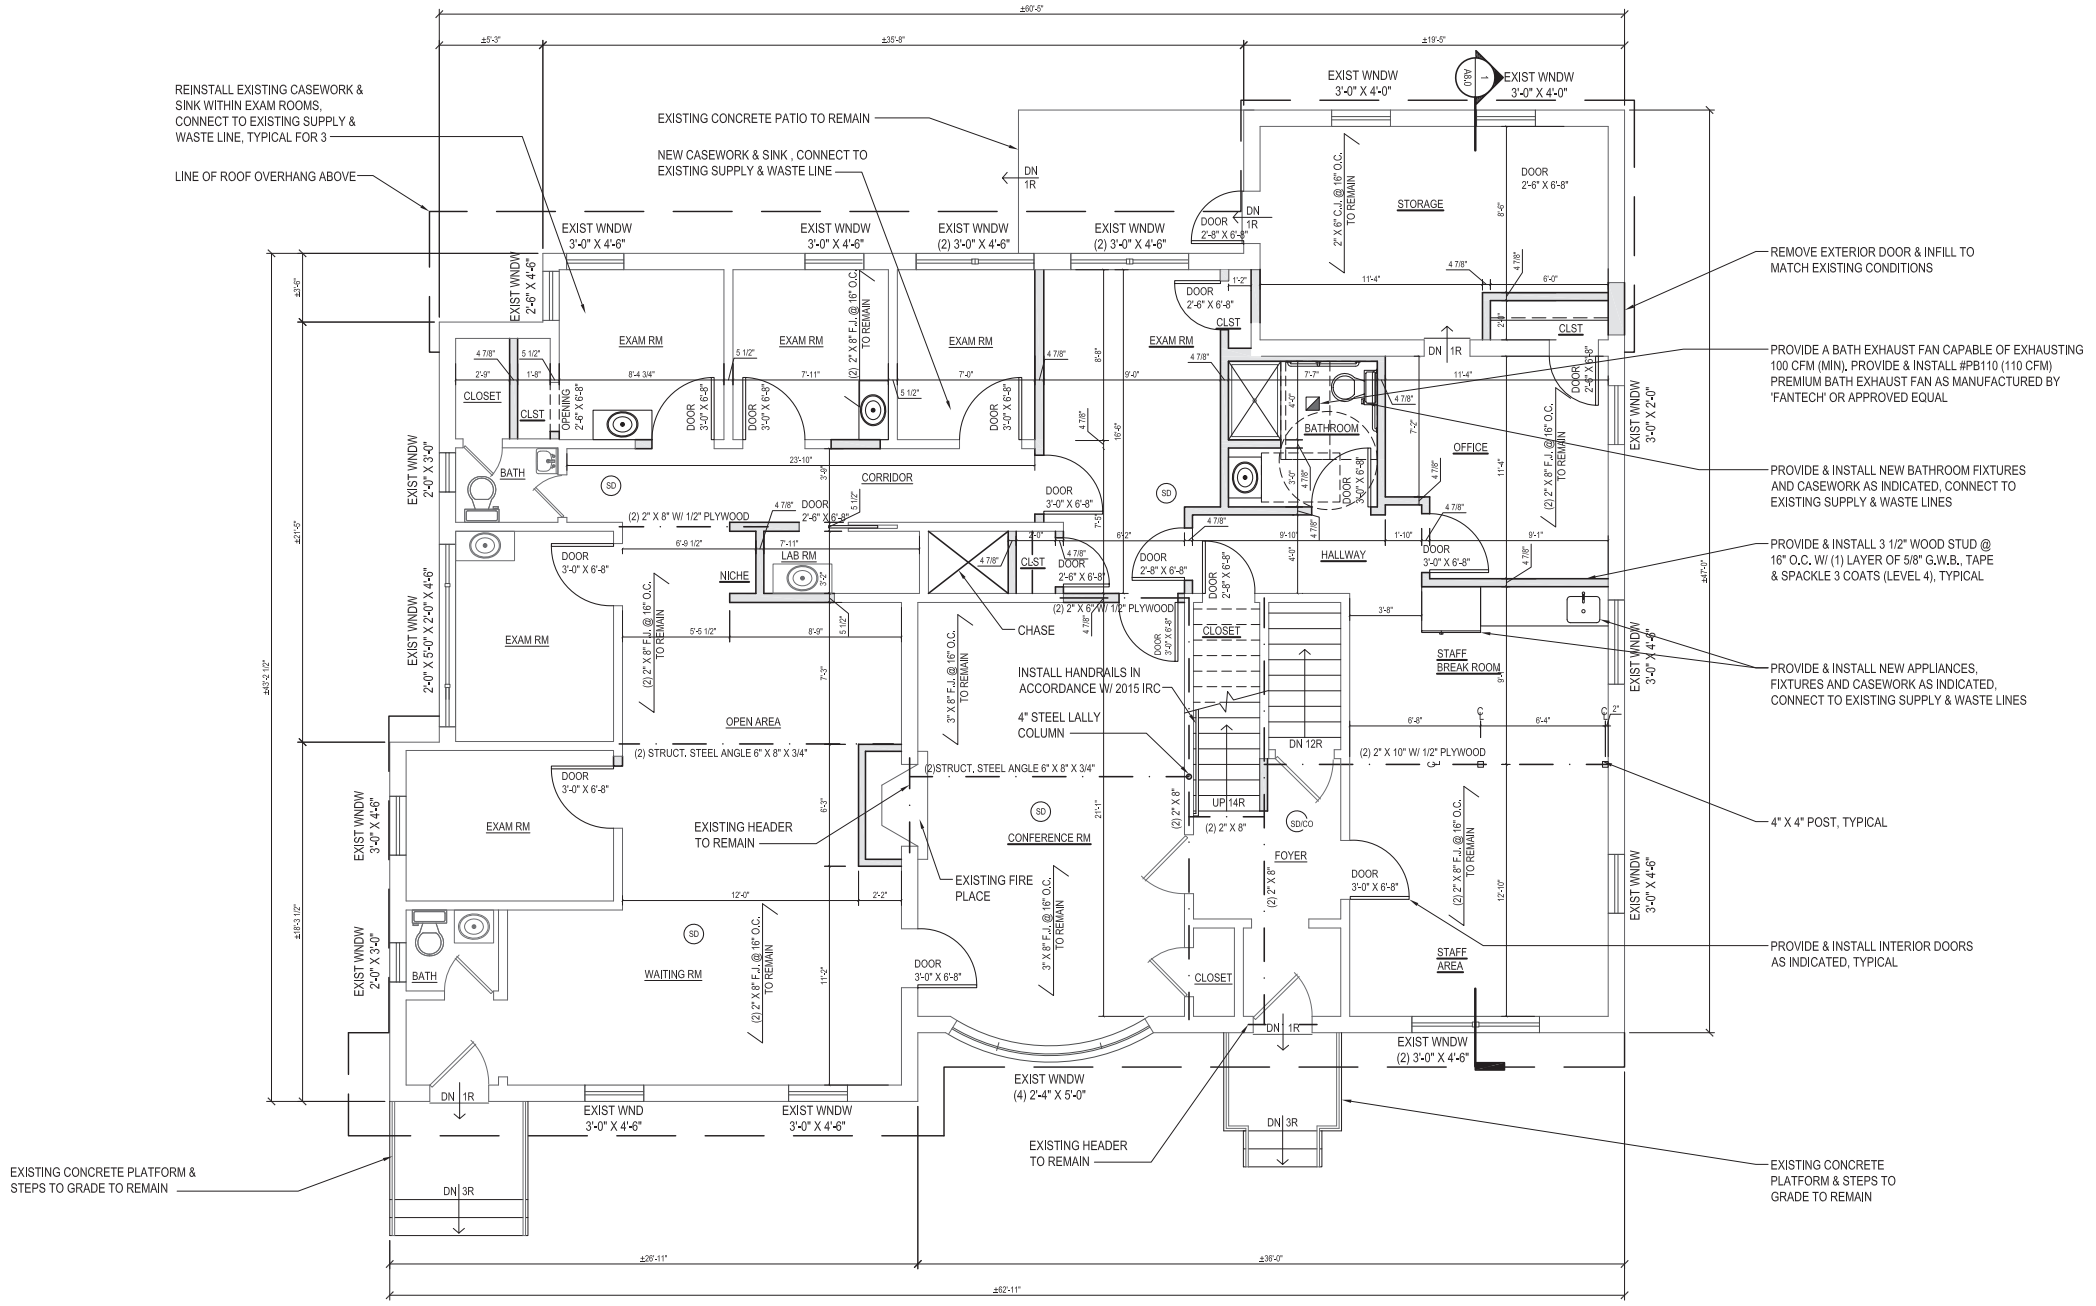
REINSTALL EXISTING CASEWORK & SINK WITHIN EXAM ROOMS, CONNECT TO EXISTING SUPPLY & WASTE LINE, TYPICAL FOR 3
LINE OF ROOF OVERHANG ABOVE
EXISTING CONCRETE PATIO TO REMAIN
NEW CASEWORK & SINK , CONNECT TO EXISTING SUPPLY & WASTE LINE
REMOVE EXTERIOR DOOR & INFILL TO MATCH EXISTING CONDITIONS
PROVIDE A BATH EXHAUST FAN CAPABLE OF EXHAUSTING 100 CFM (MIN). PROVIDE & INSTALL #PB110 (110 CFM) PREMIUM BATH EXHAUST FAN AS MANUFACTURED BY 'FANTECH' OR APPROVED EQUAL
PROVIDE & INSTALL NEW BATHROOM FIXTURES AND CASEWORK AS INDICATED, CONNECT TO EXISTING SUPPLY & WASTE LINES
PROVIDE & INSTALL 3 1/2" WOOD STUD @ 16" O.C. W/ (1) LAYER OF 5/8" G.W.B., TAPE & SPACKLE 3 COATS (LEVEL 4), TYPICAL
PROVIDE & INSTALL NEW APPLIANCES, FIXTURES AND CASEWORK AS INDICATED, CONNECT TO EXISTING SUPPLY & WASTE LINES
4" X 4" POST, TYPICAL
PROVIDE & INSTALL INTERIOR DOORS AS INDICATED, TYPICAL
EXISTING CONCRETE PLATFORM & STEPS TO GRADE TO REMAIN
EXISTING CONCRETE PLATFORM & STEPS TO GRADE TO REMAIN
EXISTING HEADER TO REMAIN
EXISTING HEADER TO REMAIN
EXISTING FIRE PLACE
CHASE
INSTALL HANDRAILS IN ACCORDANCE W/ 2015 IRC
4" STEEL LALLY COLUMN
EXAM RM
LAB RM
NICHE
CORRIDOR
BATH
CLOSET
OPENING
OPEN AREA
WAITING RM
CONFERENCE RM
STORAGE
BATHROOM
OFFICE
HALLWAY
STAFF BREAK ROOM
STAFF AREA
FOYER
EXIST WNDW 3'-0" X 4'-6"
EXIST WNDW (2) 3'-0" X 4'-6"
EXIST WNDW 2'-0" X 3'-0"
EXIST WNDW 2'-0" X 5'-0" X 2'-0" X 4'-6"
EXIST WNDW 2'-6" X 4'-6"
EXIST WNDW 3'-0" X 2'-0"
EXIST WNDW (4) 2'-4" X 5'-0"
EXIST WND 3'-0" X 4'-6"
DOOR 3'-0" X 6'-8"
DOOR 2'-6" X 6'-8"
DOOR 2'-8" X 6'-8"
(2) 2" X 8" W/ 1/2" PLYWOOD
(2) 2" X 10" W/ 1/2" PLYWOOD
(2) STRUCT. STEEL ANGLE 6" X 8" X 3/4"
(2) 2" X 8" F.J. @ 16" O.C. TO REMAIN
3" X 8" F.J. @ 16" O.C. TO REMAIN
DN 1R
DN 3R
DN 12R
UP 14R
SD
SD/CO
±60'-5"
±62'-11"
±26'-11"
±36'-0"