
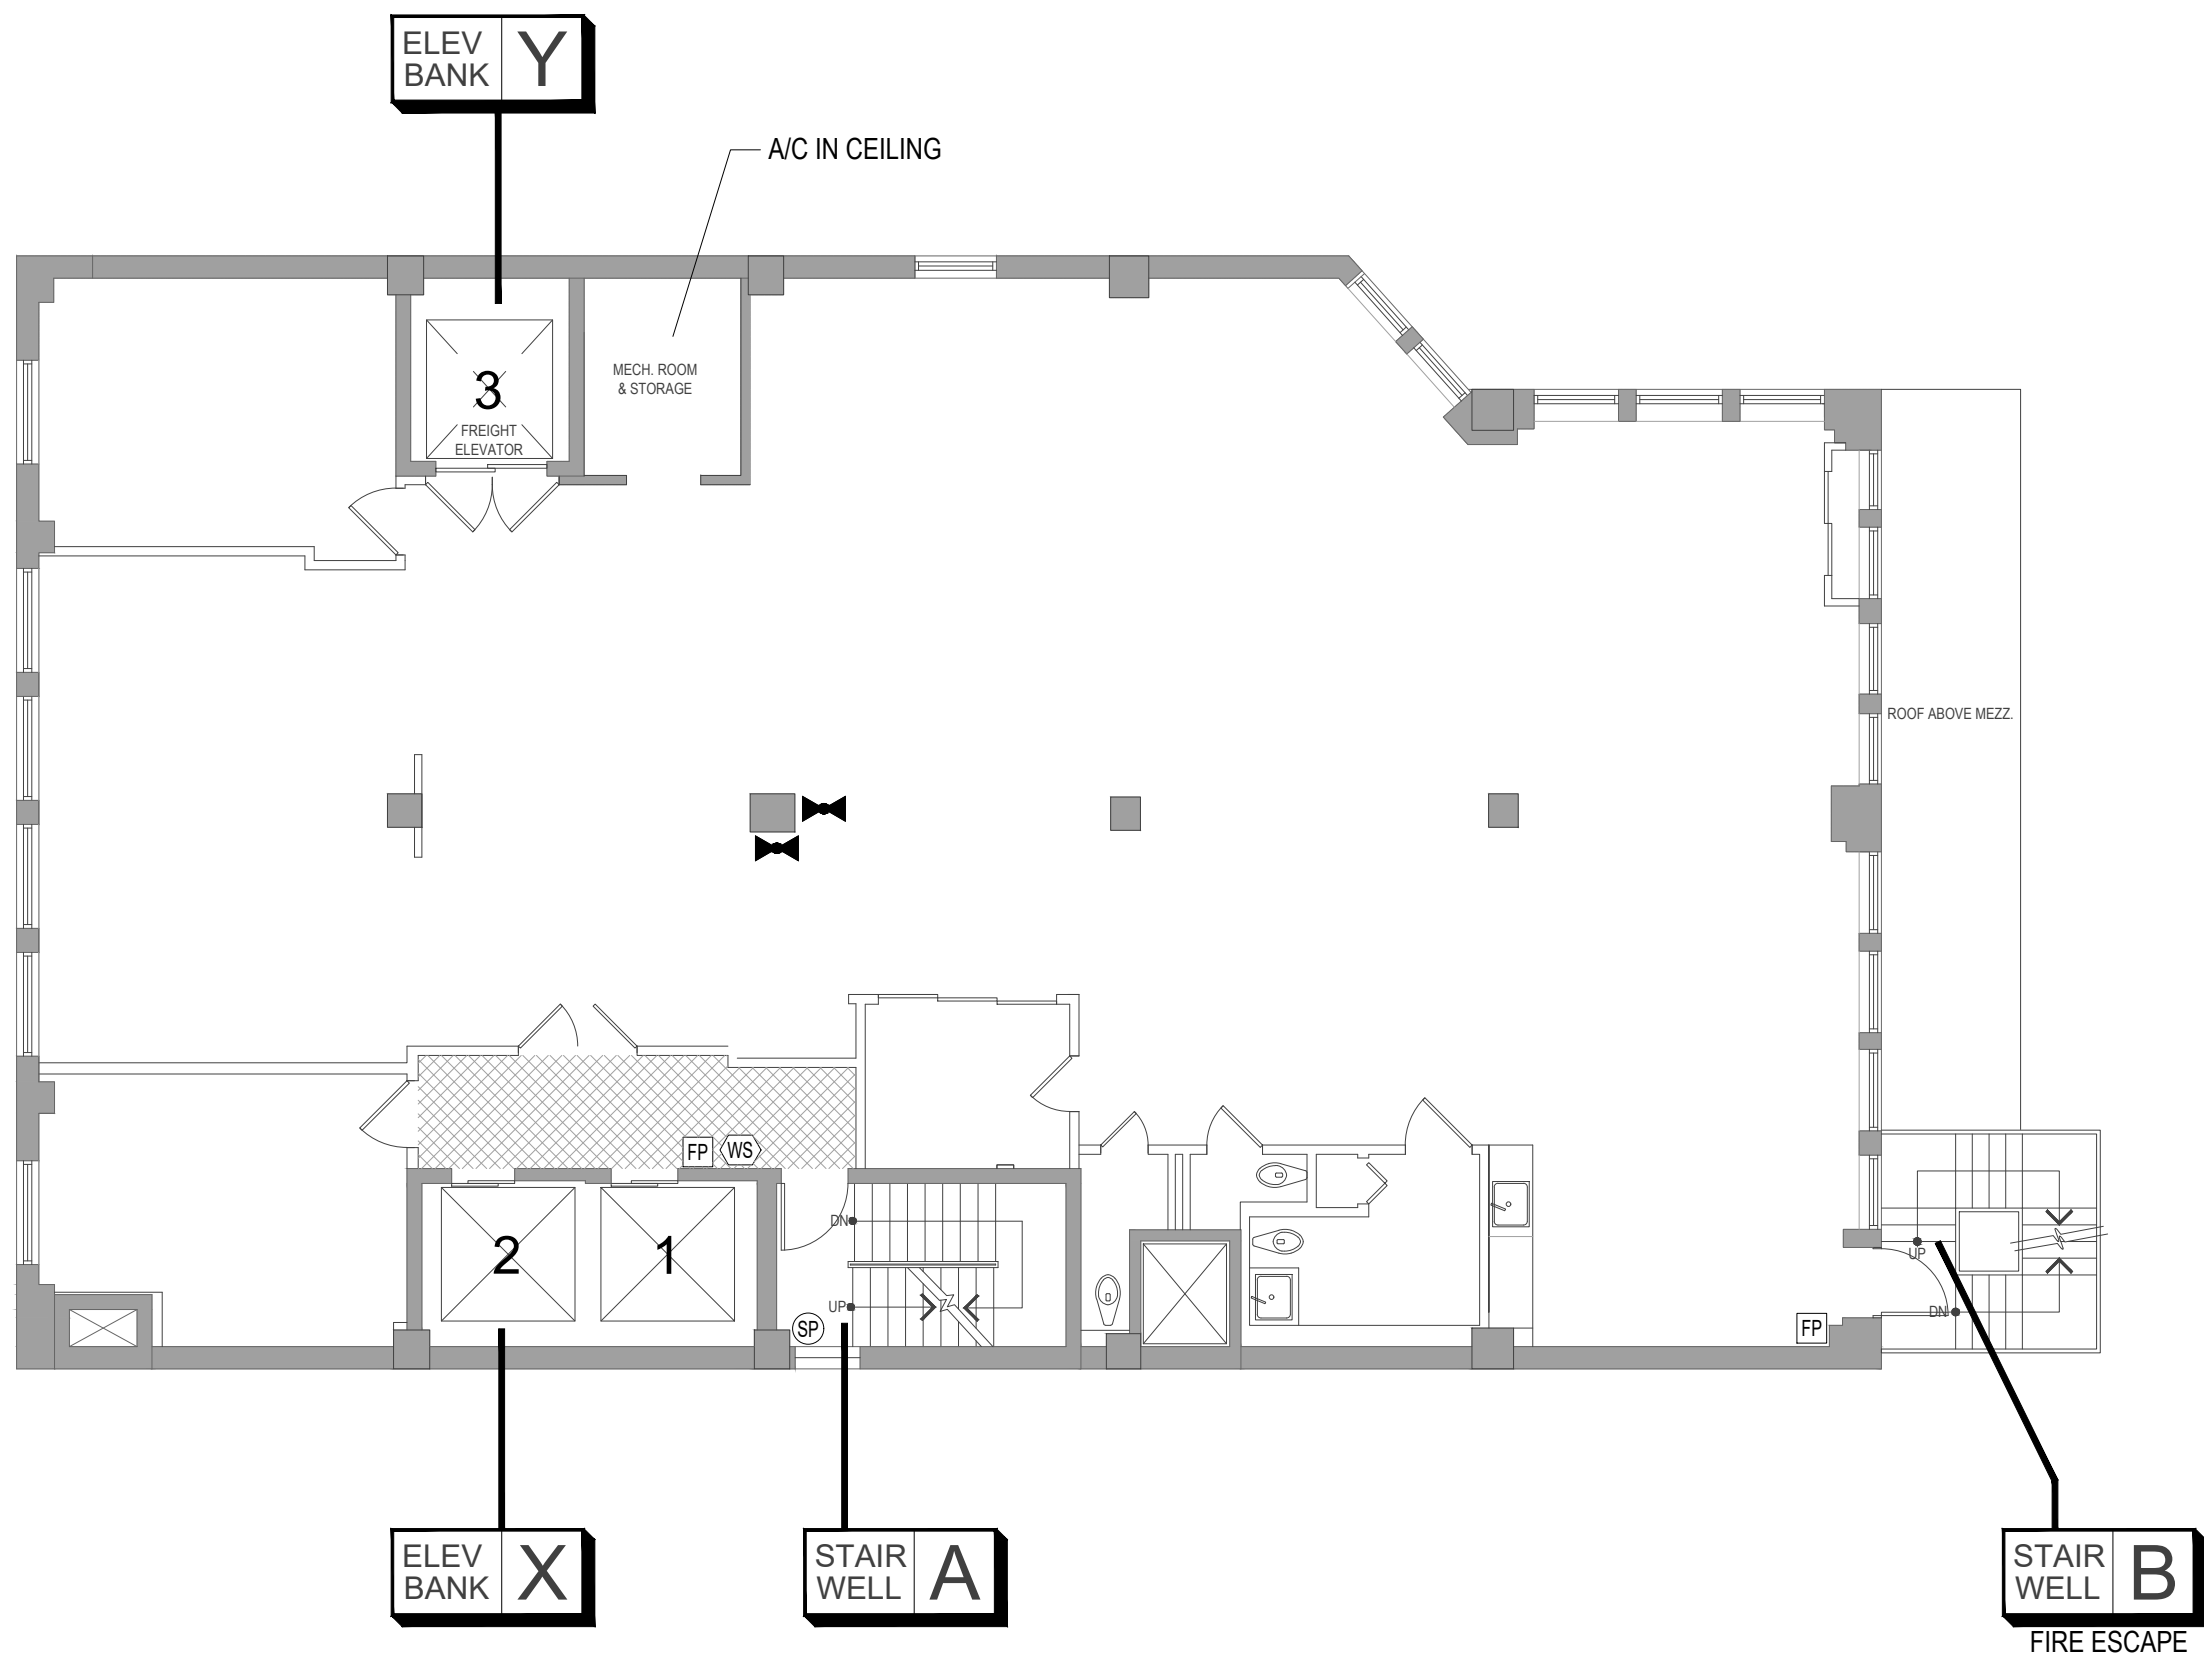


Building Engines  
 DISCLAIMER: THESE DRAWINGS WERE CREATED FOR EAP AND/OR FIRE SAFETY FILING ONLY. DRAWINGS ARE NOT TO SCALE & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

WEST 25TH STREET



# LEGEND

- FP MANUAL PULL STATION
- SP STANDPIPE HOSE OUTLET
- WS FIRE WARDEN STATION
- FCS FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- SP STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- ← EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOOR WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE	NAME	ISSUED/ COMMENTS:
1	07.15.15	CW	ISSUED FOR REVIEW
2	08.03.15	AT	ISSUED FOR REVIEW
3	06.17.19	RK	ISSUED FOR REVIEW
4	11.14.22	JG	UPDATED PER LATEST SURVEY ISSUED FOR REVIEW AND FILING

DRAWN BY/DATE: JG/AT      CHECKED BY/DATE: XXX

BUILDING ADDRESS:  
**36 West 25th Street**  
 New York, N.Y. 10010

DRAWING TITLE:  
FL-9  
 9th Floor

SURVEY BY:  
 JG

FULL SPRINKLER COVERAGE