


LEGEND	
[M] MANUAL PULL STATION	[FCS] FIRE COMMAND STATION
[SP] STANDPIPE HOSE OUTLET	[FDC] FIRE DEPT. CONNECTION (SIAMOSE CONNECTION)
[WS] FIRE WARDEN STATION	[S] STANDPIPE CONTROL VALVE
[FCS] FIRE COMMAND STATION	[S] SPRINKLER CONTROL VALVE
[FDC] FIRE DEPT. CONNECTION (SIAMOSE CONNECTION)	[D] DOMESTIC WATER MAIN CONTROL VALVE
[S] STANDPIPE CONTROL VALVE	[E] EVACUATION ROUTE
[S] SPRINKLER CONTROL VALVE	[F] FURNITURE/EQUIPMENT
[D] DOMESTIC WATER MAIN CONTROL VALVE	[N] NON-RATED PARTITION
[E] EVACUATION ROUTE	[1-HR] 1-HR FIRE BARRIER
[F] FURNITURE/EQUIPMENT	[FB] FIRE BARRIER
[N] NON-RATED PARTITION	[NSA] NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
[1-HR] 1-HR FIRE BARRIER	[R] REBUILDING/RELOCATION AREAS (IBRA)
[FB] FIRE BARRIER	
[NSA] NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)	
[R] REBUILDING/RELOCATION AREAS (IBRA)	

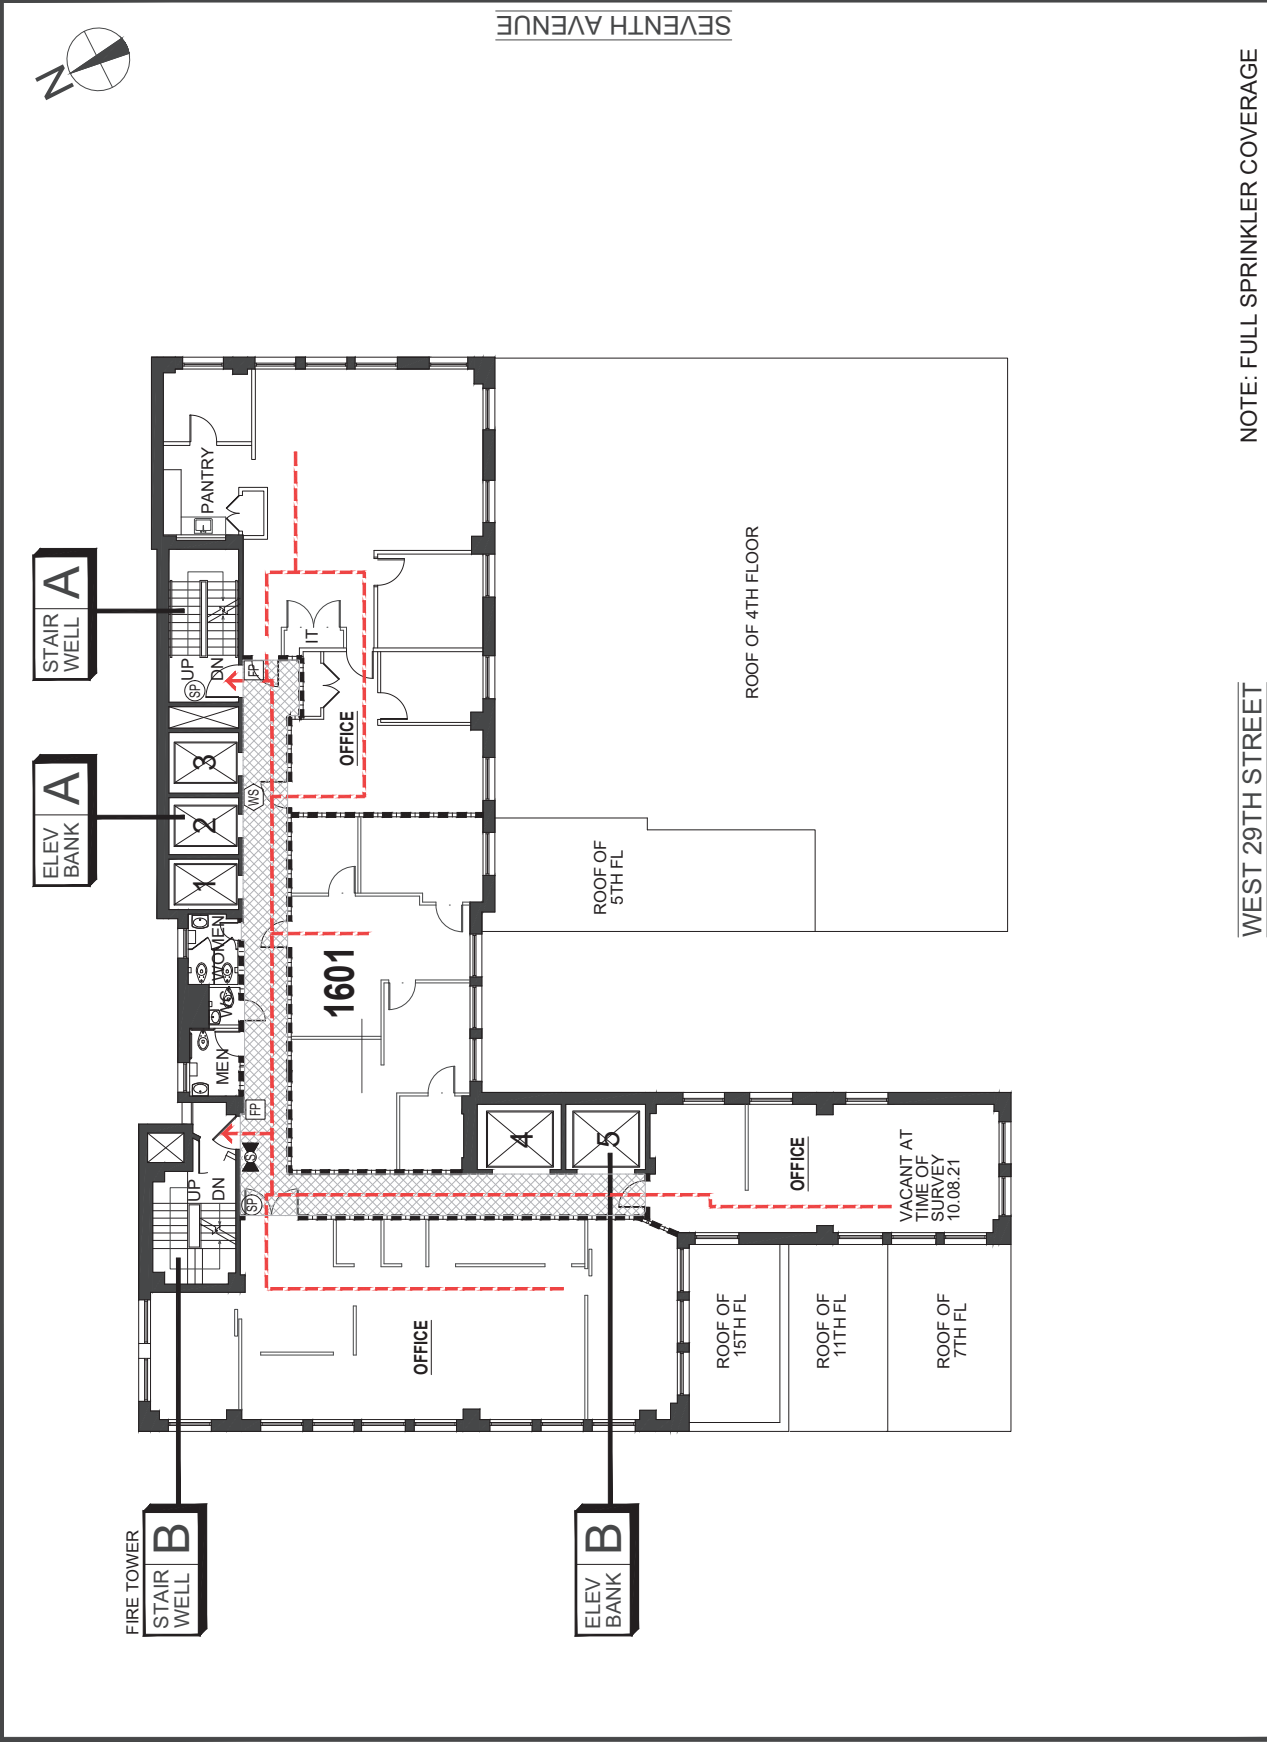

NO. DATE NAME ISSUED COMMENTS

1	11.08.21	JW	ISSUED FOR SURVEY 10.08.21
---	----------	----	----------------------------

DRAWN BY/DATE: KM

CHECKED BY/DATE: DL

BUILDING ADDRESS:
350 SEVENTH AVE.
 NEW YORK, NY 10001

DRAWING TITLE:
FL-16
16TH FLOOR

SURVEY BY: KM | SURVEY DATE(S): 10.06.21