



DOOR SCHEDULE

NO.	TYPE	SIZE	DESCRIPTION	FRAME	HARDWARE	NOTES
1	A	3'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 4 1/2 x 4 1/2 8.6.	1. ALL LOCKSETS SHALL BE LEVER HANDLE SCHLAGE "SANTURN" COMMERCIAL DUTY.
2	B	3'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 3 1/2 x 3 1/2	2. HARDWARE FINISH US26D
3	B	3'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 3 1/2 x 3 1/2	3. HINGES HAGER OR EQUAL
4	B	3'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 3 1/2 x 3 1/2	LOCKS SHALL NOT REQUIRE USE OF KEY, TOOL OR SPECIAL KNOWLEDGE OR EFFORT FOR OPERATION FROM EGRESS SIDE.
5	B	3'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 3 1/2 x 3 1/2	
6	B	3'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 3 1/2 x 3 1/2	
7	B	3'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 3 1/2 x 3 1/2	
8	C	2'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 3 1/2 x 3 1/2	
9	D	3'-0" x 8'-0"	INSUL. HOLLOW METAL GLASS	ALUM.	3 BUTTS, 3 1/2 x 3 1/2	

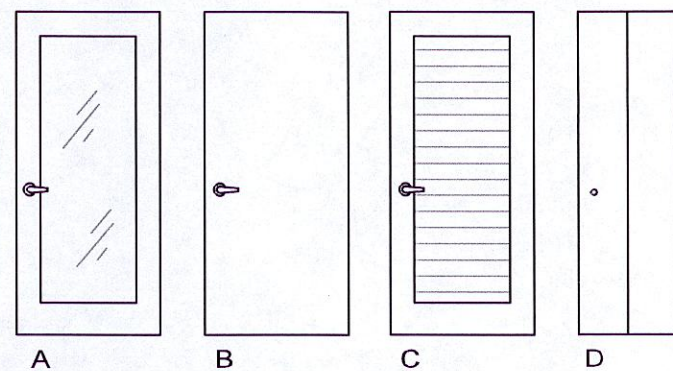


DOOR TYPES

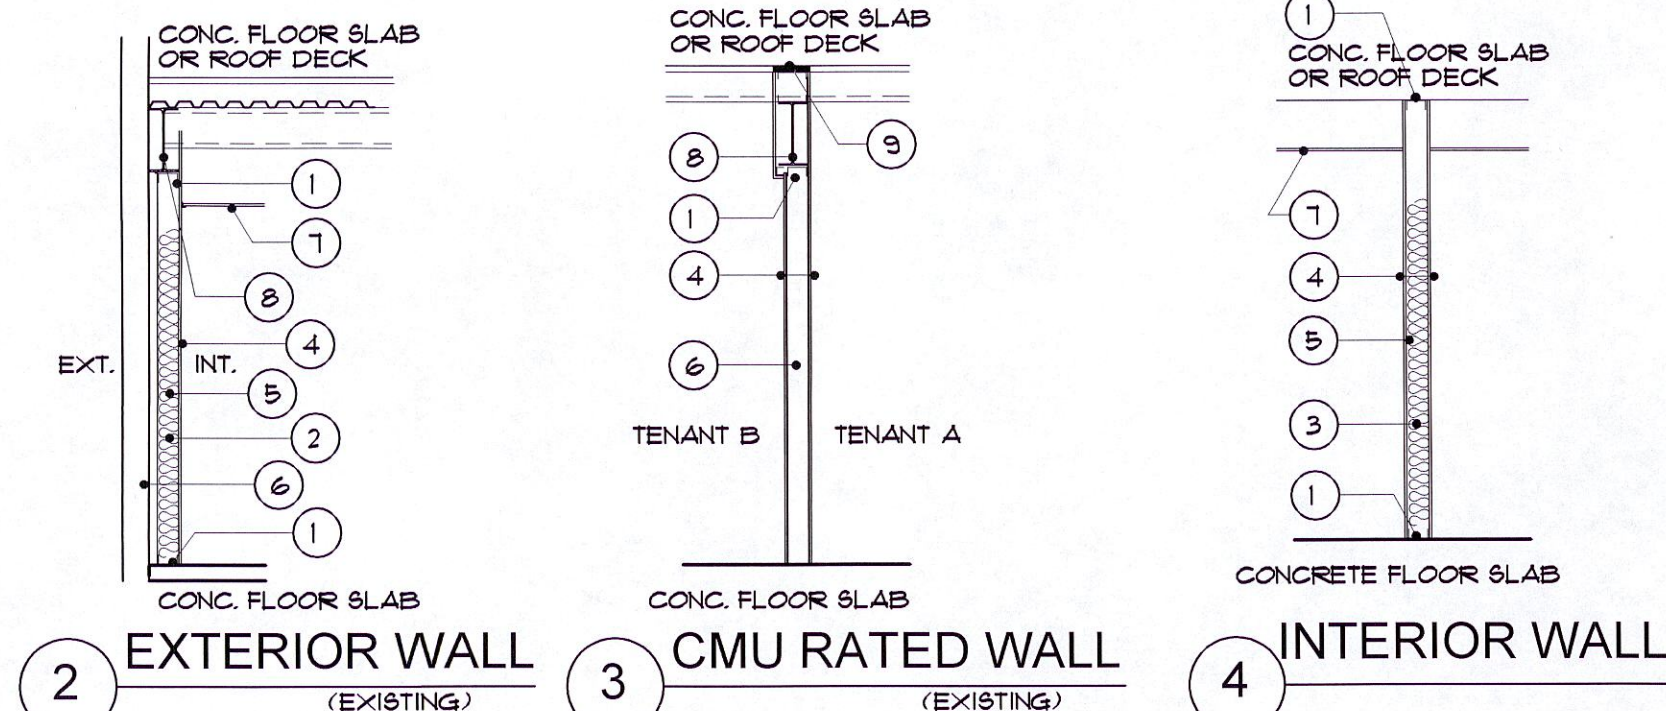

1. TOP AND BOTTOM RUNNERS
2. R-11 FIBERGLASS INSULATION (EXISTING)
3. SOUND INSULATION AND PERIMETER SOUND ATTENUATION SEALANT (WHERE NOTED ON PLAN)
4. 1/2" GYP. BD. WALLS, 5/8" AT FIRE RATED ASSEMBLIES
5. GALV. METAL STUDS, MIN. 24" O.C. MIN. 25 GAUGE (FOR DEPTH SEE PLAN)
6. CMU WALL (EXISTING)
7. SUSPENDED ACOUSTICAL CEILING
8. STEEL BEAM
9. FIRESAFING SEE U.L. SYSTEM HW-D-0041

NOTE: INTERIOR PARTITIONS STUDS SHALL BE FASTENED TO TOP AND BOTTOM TRACK WITH 1" X 10 TEK SCREW EACH SIDE OF EACH STUD. BOTTOM TRACK SHALL BE FASTENED TO FLOOR WITH PAF AT 24" AND TOP TRACK SHALL BE BRACED TO STRUCTURE ABOVE IF AND AS REQUIRED TO RESIST AT LEAST 5 PSF.

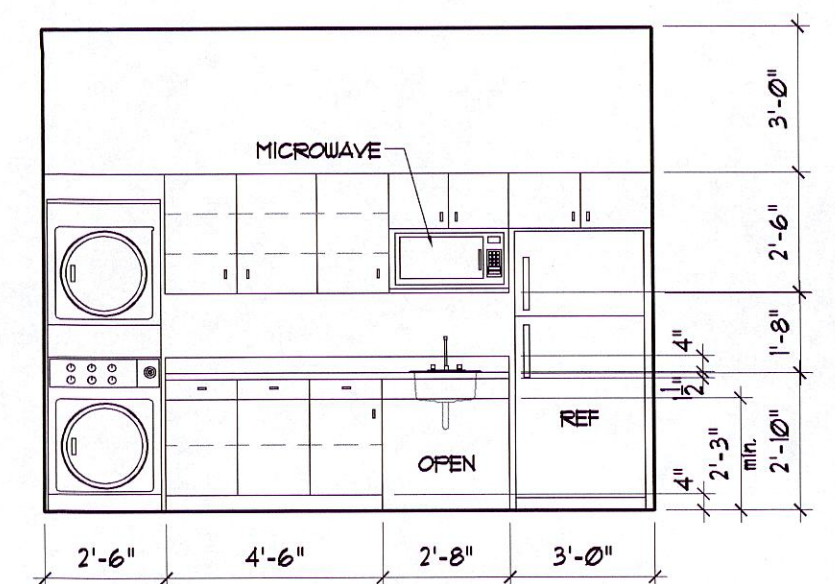

5 BREAK ELEVATION
SCALE: 1/4"=1'-0"

LEGEND

- 1 DOOR NUMBER
- EXISTING 8" CMU WALL
- PROPOSED METAL FRAME PARTITIONS
- EXHAUST FAN
- 2A 10b c FIRE EXTINGUISHER, 5lb.

FINISH SCHEDULE

NO.	ROOM	FLOOR	BASE	WALLS	CLG	HT.	NOTES
1	TREATMENT Rm. 1 & 2		WOOD CERAMIC TILE	WOOD CERAMIC TILE	WOOD CERAMIC TILE	11'-0"	FINISH ON INTERIOR WALLS & CLG SHALL BE MINIMUM CLASS "C"
2	TREATMENT Rm. 3-7		CARPET	CARPET	CARPET	10'-0"	PROVIDE PLYWOOD BACKING FOR ALL WALL MTD FIXTURES
3	OFFICES 1-4		VCT	VCT	VCT	11'-0"	*ALL FINISHES AND COLORS TO BE SELECTED BY OWNER
4	OFFICE 5		VCT	VCT	VCT	10'-0"	
5	EQUIPMENT/THERAPY		VCT	VCT	VCT	10'-0"	
6	RECEPTION		VCT	VCT	VCT	10'-0"	
7	TOILET		VCT	VCT	VCT	10'-0"	
8	X-RAY / DARK ROOM		VCT	VCT	VCT	10'-0"	
9	WAITING ROOM		VCT	VCT	VCT	10'-0"	
10	BREAK		VCT	VCT	VCT	10'-0"	
11	KIDS PLAYROOM		VCT	VCT	VCT	10'-0"	


X-RAY ROOM ADJACENT OCCUPANCIES:

North: Corridor
South: Dark room
East: Equipment open area
West: N/A Exterior wall

Note: Due to the equipment beam's general direction, the adjacent areas affected are to the north and below the x-ray room. The north wall is protected by 1/2" lead lining from floor to ceiling. The area below is separated by a concrete and steel floor/ceiling and is not required for protective lining.

ALL FINISHES, COLORS & STAINS SHALL BE SELECTED AND APPROVED BY OWNER
NOTE: ALL FINISHES SHALL BE IN ACCORDANCE WITH NFPA 101:102.

EXISTING CMU RATED WALL

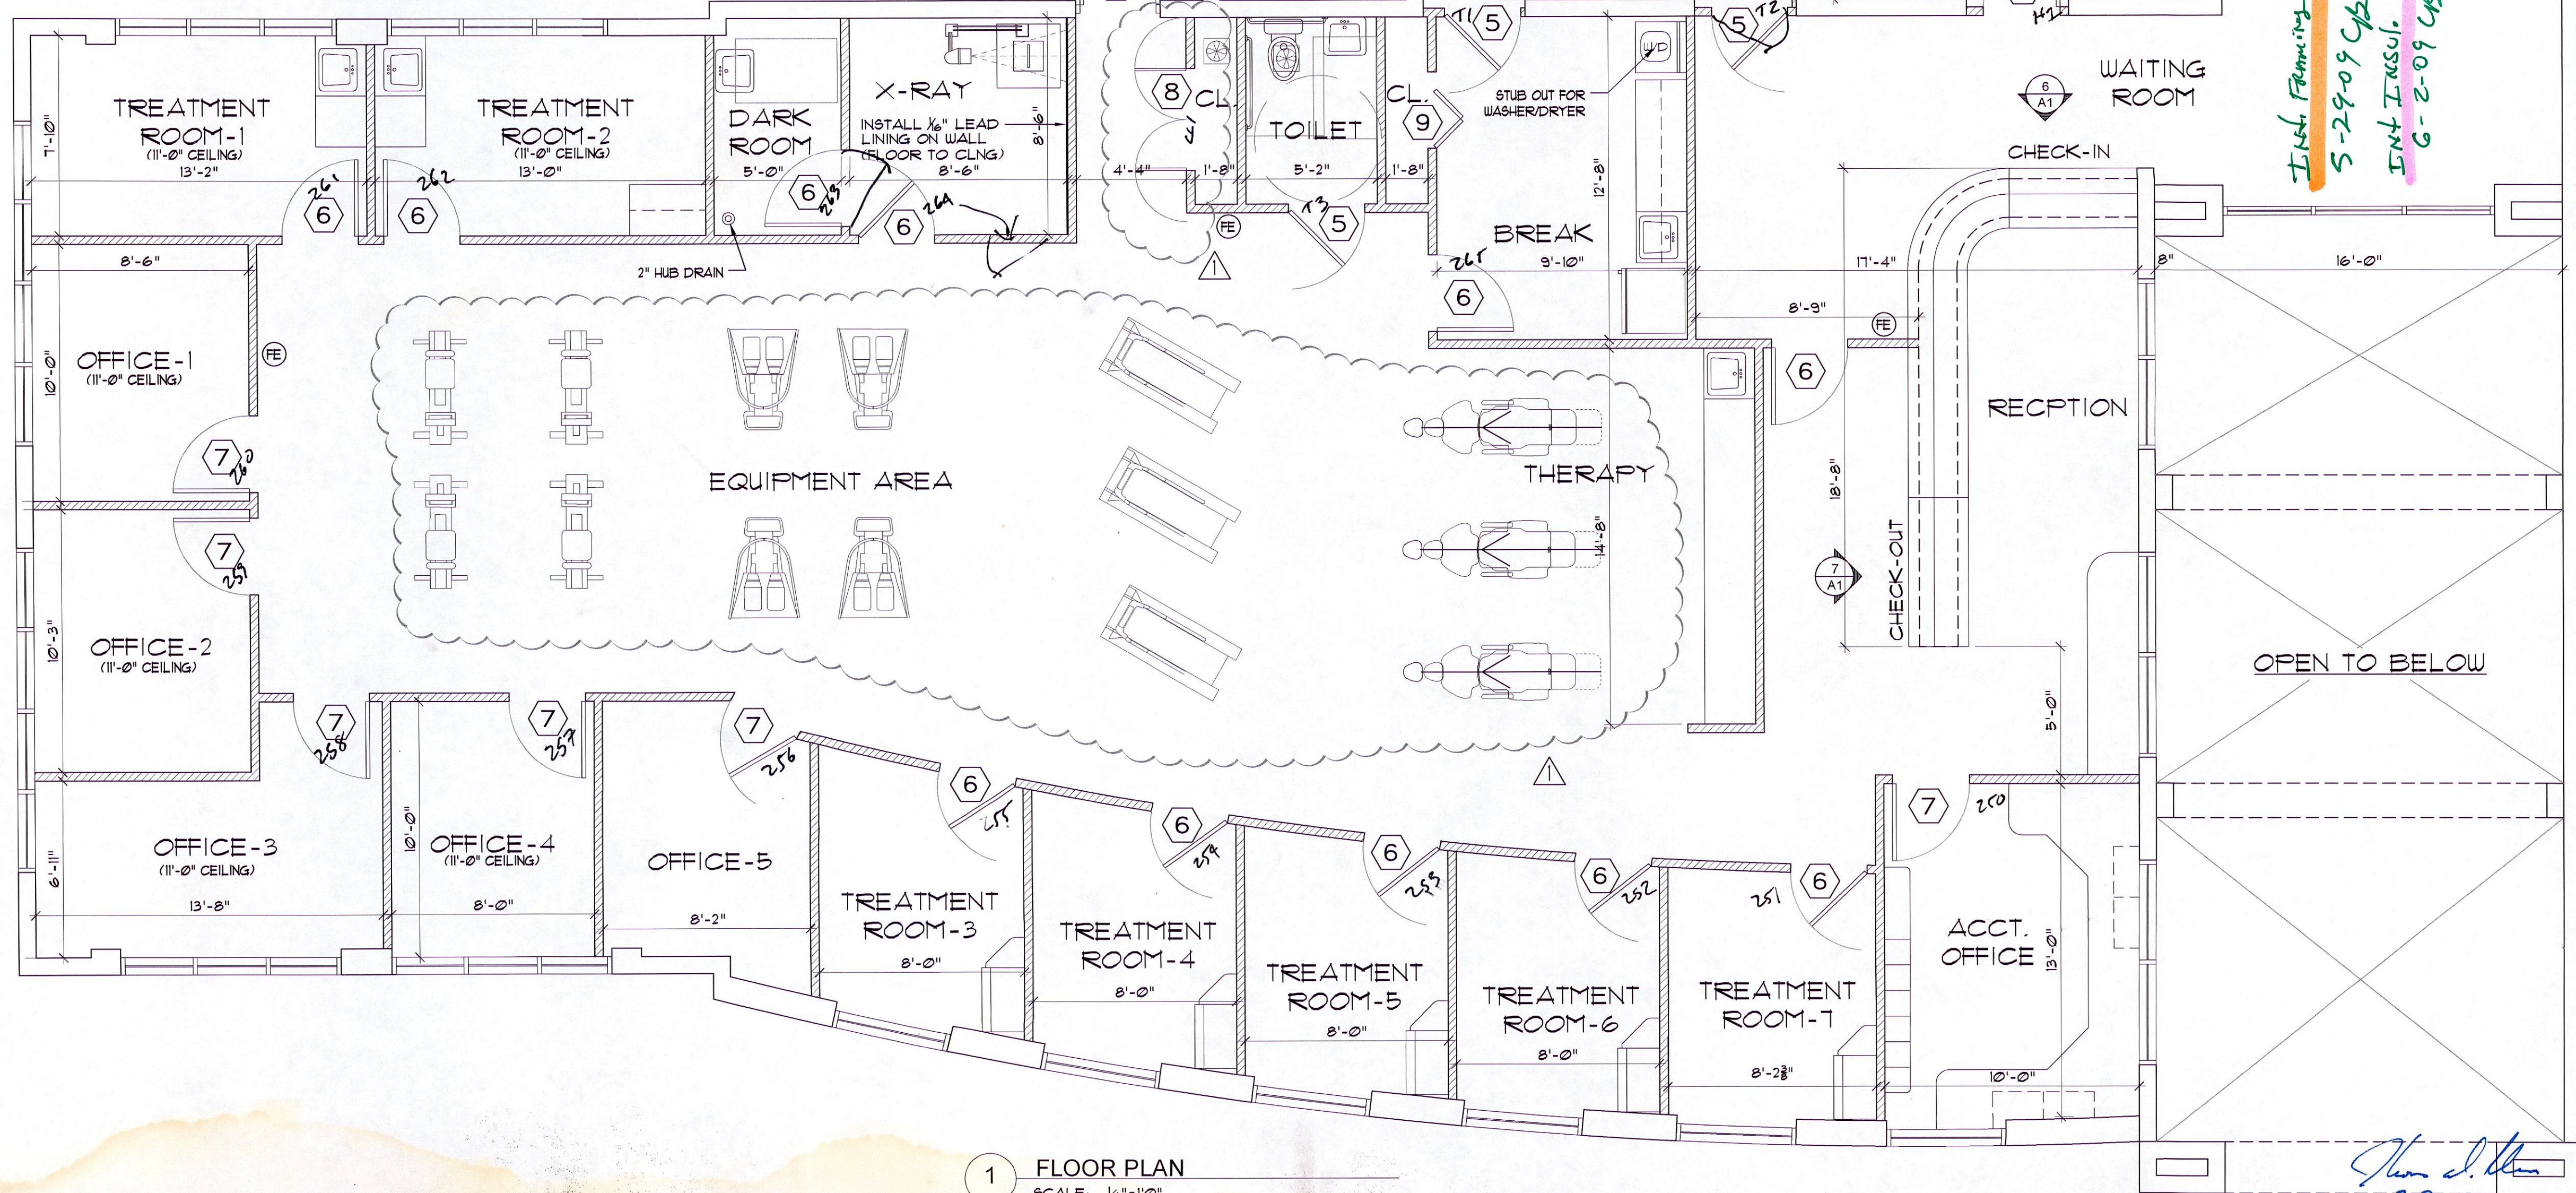

1 FLOOR PLAN
SCALE: 1/4"=1'-0"

6 Check-In Elevation
SCALE: 1/4"=1'-0"

7 Check-Out Elevation
SCALE: 1/4"=1'-0"