

LEGEND	
[FP]	MANUAL PULL STATION
[SP]	STANDPIPE HOSE OUTLET
[WS]	FIRE WARDEN STATION
[FCS]	FIRE COMMAND STATION
[FC]	FIRE DEPT. CONNECTION (SIAMOSE CONNECTION)
[S]	STANDPIPE CONTROL VALVE
[S]	SPRINKLER CONTROL VALVE
[D]	DOMESTIC WATER MAIN CONTROL VALVE
[E]	EVACUATION ROUTE
[F]	FURNITURE/EQUIPMENT
[P]	NON-RATED PARTITION
[B]	1-HR FIRE BARRIER
[W]	FIRE BARRIER
[N]	NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
[R]	REBUILDING RELOCATION AREAS (IBRA)


NO.	DATE	NAME	REVISION COMMENTS
1	11.08.21	JW	ISSUED FOR PERMIT AND RING

DRAWN BY/DATE:	CHECKED BY/DATE:
KM	DL

BUILDING ADDRESS:
350 SEVENTH AVE.
NEW YORK, NY 10001

DRAWING TITLE:
FL-20
20TH FLOOR

SURVEY BY: | SURVEY DATE(S):
 KM | 10.06.21

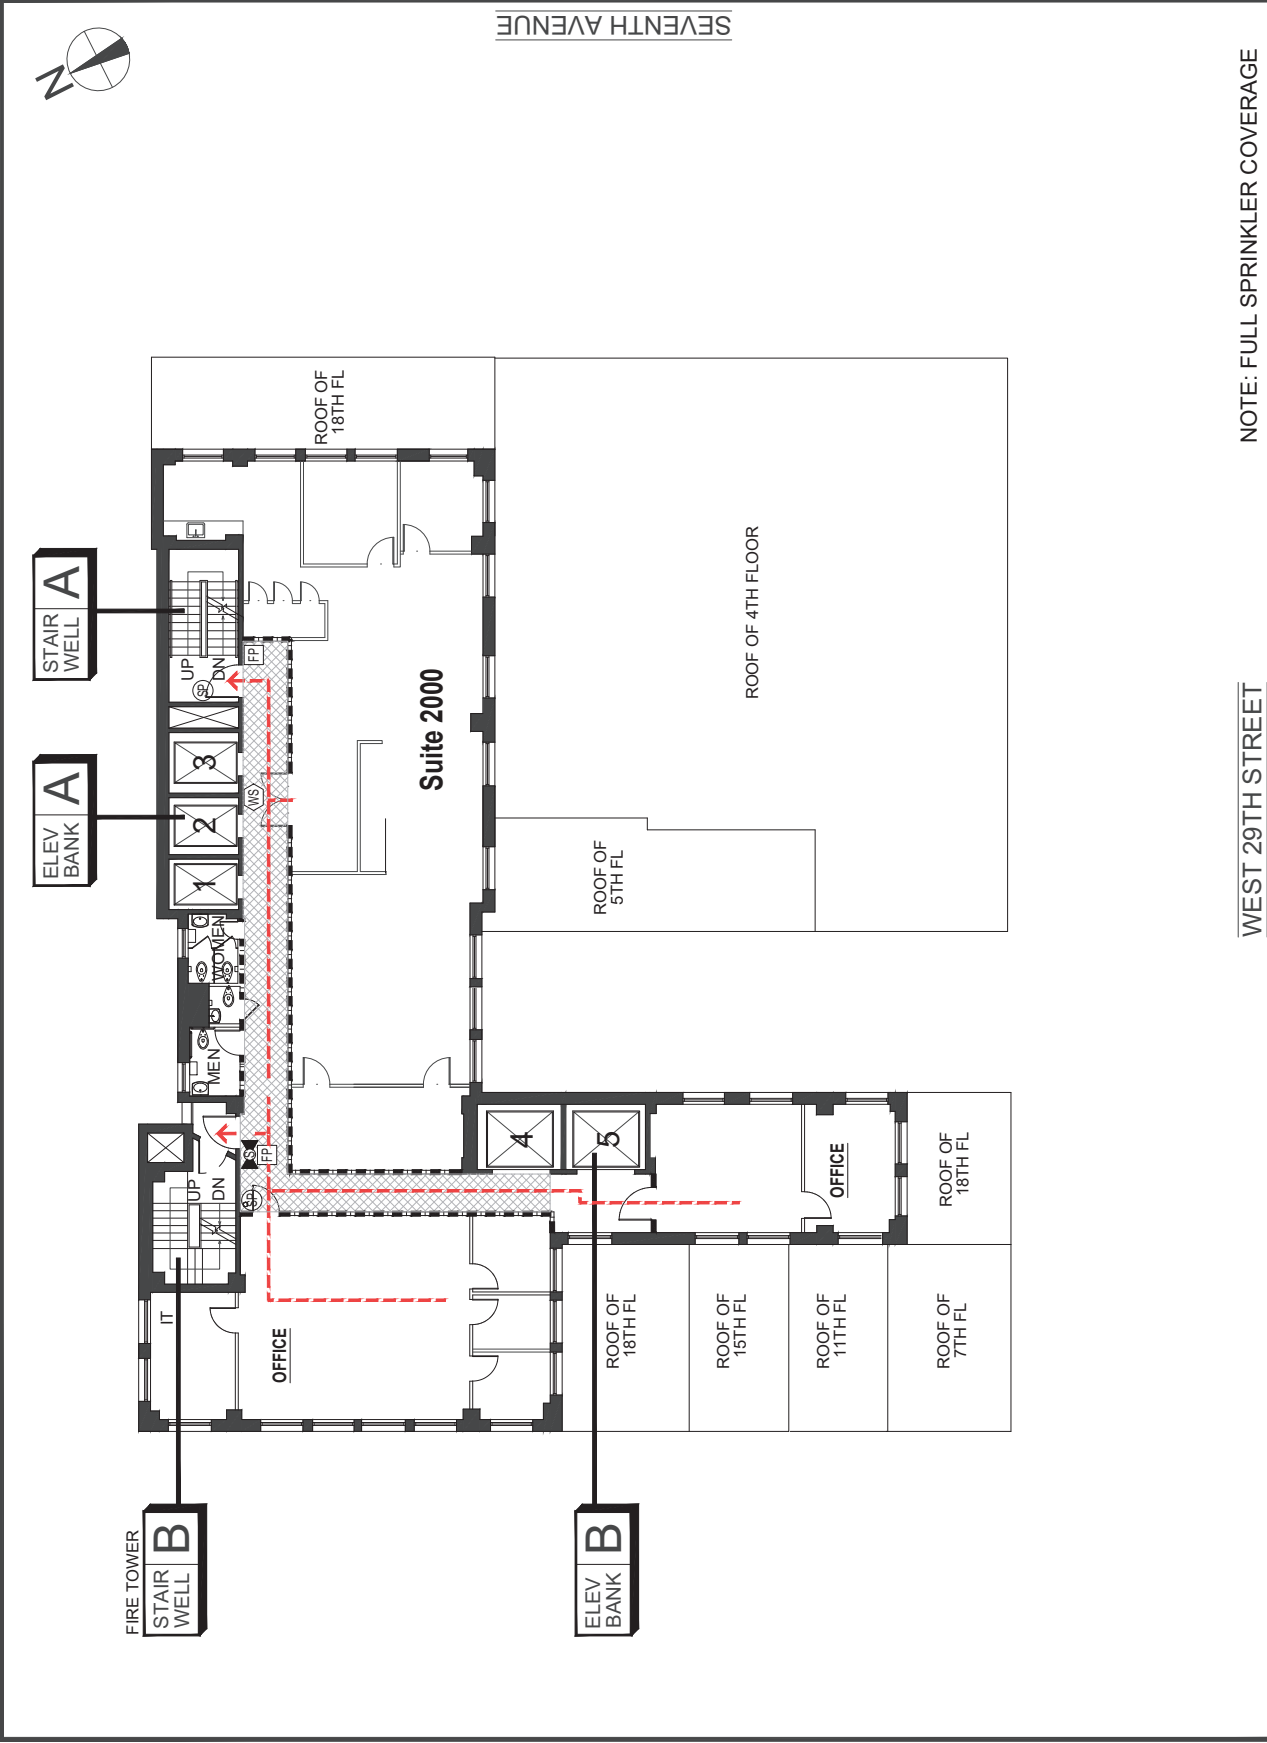

NOTE: FULL SPRINKLER COVERAGE

WEST 29TH STREET

SEVENTH AVENUE