


**FIRST LEVEL FLOOR PLAN**  
N.T.S.

SYM.	DESCRIPTION
[LACP]	FIRE ALARM CONTROL PANEL
[SHE]	SUPPLEMENTAL NOTIFICATION APPLIANCE CIRCUIT
[F]	FIRE ALARM PULL STATION
[◇]	PHOTOELECTRIC SMOKE DETECTOR
[◇]	IONIZATION SMOKE DETECTOR
[◇]	HEAT DETECTOR
[18ce] [◇]	HYDRANT LIGHT COMBINATION
[25ce] [◇]	HYDRANT LIGHT COMBINATION
[17ce] [◇]	HYDRANT LIGHT COMBINATION
[18ce] [◇]	FLASHING LIGHT-WALL MOUNT
[25ce] [◇]	FLASHING LIGHT-WALL MOUNT
[140]	140° HEAT DETECTOR
[AM]	ADDRESSABLE OUTPUT MODULE
[AM]	ADDRESSABLE MONITOR MODULE

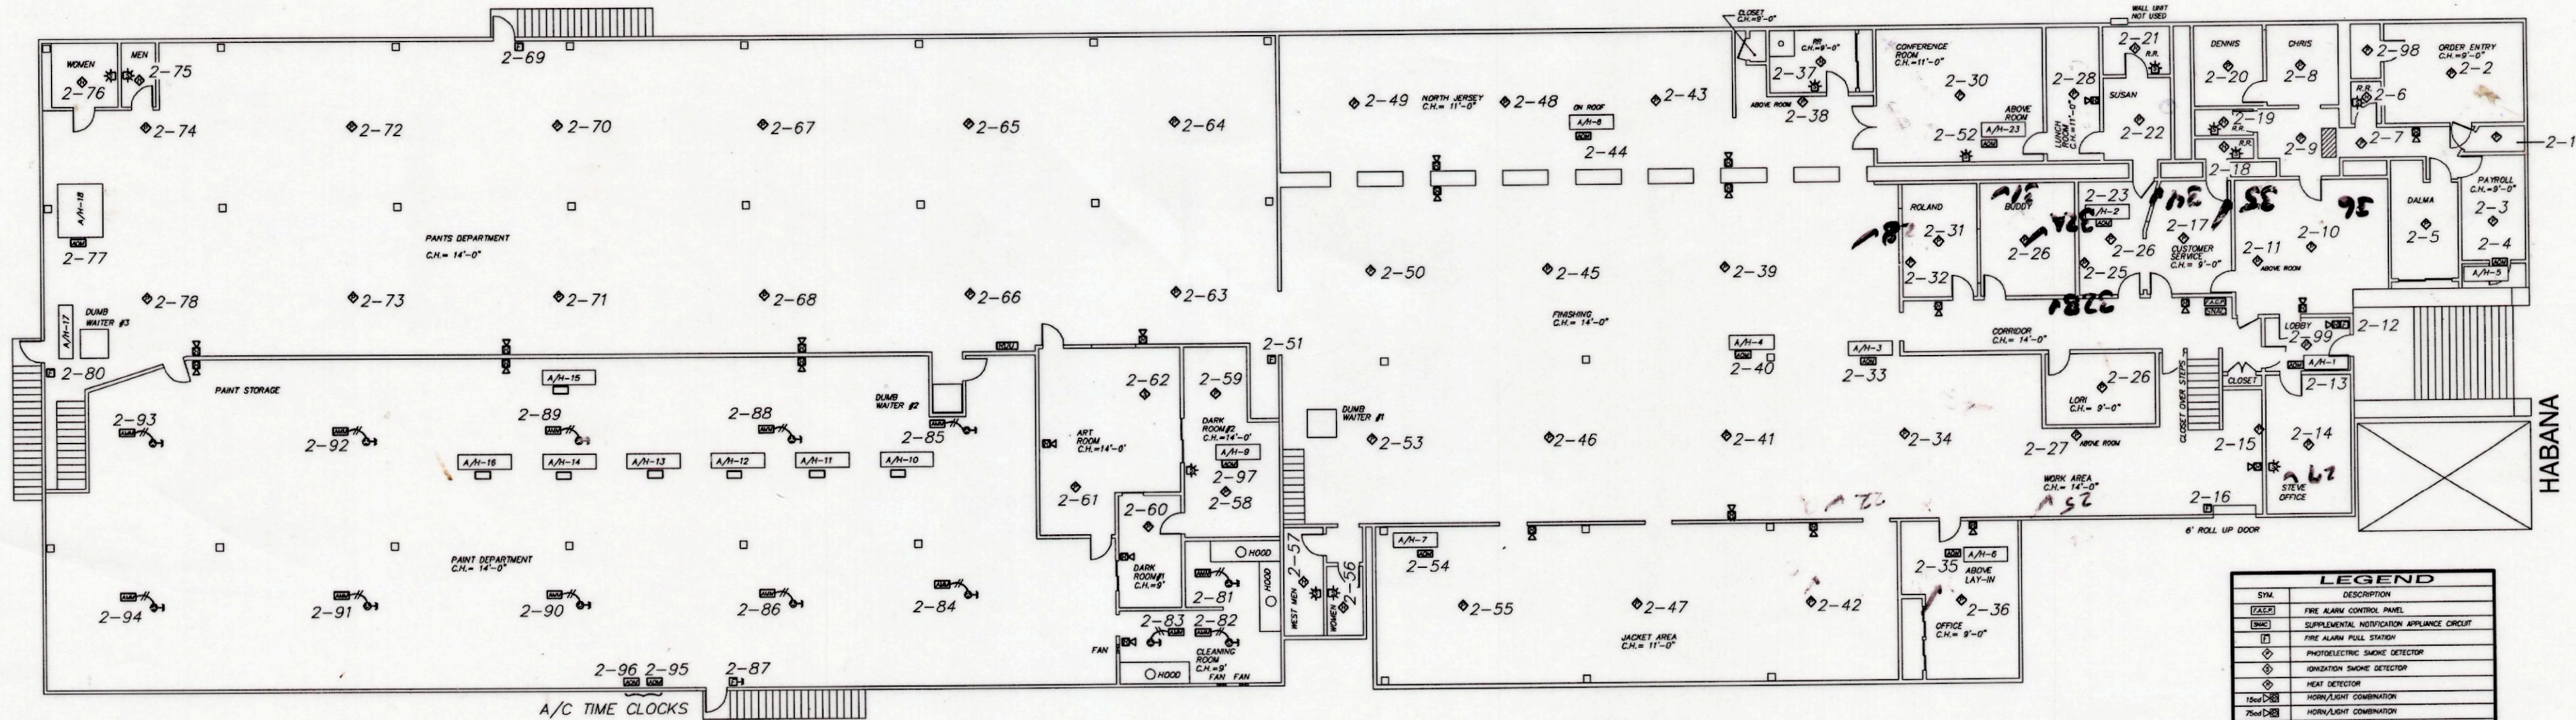

**SECOND LEVEL FLOOR PLAN**  
N.T.S.

LEGEND	
SYM.	DESCRIPTION
[Symbol]	FIRE ALARM CONTROL PANEL
[Symbol]	SUPPLEMENTAL NOTIFICATION APPLIANCE CIRCUIT
[Symbol]	FIRE ALARM PULL STATION
[Symbol]	PHOTOELECTRIC SMOKE DETECTOR
[Symbol]	IONIZATION SMOKE DETECTOR
[Symbol]	HEAT DETECTOR
12sec [Symbol]	HORN/LIGHT COMBINATION
75sec [Symbol]	HORN/LIGHT COMBINATION
110sec [Symbol]	HORN/LIGHT COMBINATION
15sec [Symbol]	FLASHING LIGHT-WALL MOUNT
75sec [Symbol]	FLASHING LIGHT-WALL MOUNT
[Symbol]	140° HEAT DETECTOR
[Symbol]	ADDRESSABLE OUTPUT MODULE
[Symbol]	ADDRESSABLE MONITOR MODULE