**FIRE ALARM NOTES**

1. STROBES WILL REMAIN FLASHING ON SYSTEM SILENCE.
2. ALL REMOTE ANNUNCIATOR'S WILL BE INCAPABLE OF CONTROLLING FIRE ALARM AND WILL BE FOR ZONE/DEVICE IDENTIFICATION ONLY.
3. ALL PULL STATIONS LOCATED IN PUBLIC AREAS OR AREAS WHERE THEY ARE SUBJECT TO IMPACT DAMAGE ARE TO BE FITTED WITH PROTECTIVE SOUND COVERS.
4. ANY/ALL KEYS AND TOOLS REQUIRED TO RESET ALL COMPONENTS OF THE FIRE ALARM SYSTEM WILL BE LEFT ON SITE. (THIS INCLUDES PANEL KEYS, PROPER SIZE ALLEN KEYS OR PROPER TYPE OF SCREWDRIVER(S) NECESSARY TO RESET PULL STATIONS.
5. ALL DETECTORS LOCATED IN CONCEALED AREAS AND SPACES SHALL HAVE REMOTE INDICATING LIGHTS MOUNTED IN A CLEARLY VISIBLE AREA AS CLOSE AS POSSIBLE TO THE LOCATION OF THE DETECTOR.
6. FIRE ALARM CONTROL PANEL (FACP) OR A REMOTE ANNUNCIATOR SHALL BE INSTALLED AT THE MAIN ENTRANCE IN A MANNER WHERE IT IS READILY VISIBLE AND READABLE FROM THE EXTERIOR OF THE BUILDING. THIS REMOTE ANNUNCIATOR WILL NOT BE CAPABLE OF CONTROLLING ANY FUNCTION OF THE FIRE ALARM SYSTEM AND WILL BE FOR ANNUNCIATION ONLY.
7. CIRCUIT BREAKER AND PANEL NUMBER AS WELL AS THE CENTRAL STATION ACCOUNT NUMBER ARE TO BE NOTED ON THE INSIDE OF THE FACP DOOR.
8. ALL TRANSMITTING EQUIPMENT SHALL HAVE TWO TELEPHONE LINES AVAILABLE AND BE LISTED FOR COMMERCAIL FIRE APPLICATIONS.
9. ALL SMOKE DETECTORS TO BE USED ARE TO BE EQUIPPED WITH A STEADY RED INDICATOR LIGHT THAT WILL ILLUMINATE UPON ACTIVATION. LIGHT MUST REMAIN ILLUMINATED UNTIL PANEL IS RESET.
10. 24 HOUR EMERGENCY SERVICE TELEPHONE NUMBER FOR FIRE ALARM CONTRACTOR IS TO BE CONSPICUOUSLY POSTED ON THE FIRE ALARM PANEL. ALARM CONTRACTOR MUST BE AVAILABLE FOR 24 HOUR SERVICE ON THIS SYSTEM.
11. COMPLETE AND IMMEDIATE FAN SHUT DOWN IS REQUIRED UPON ACTIVATION OF ANY PART OF THE INSTALLED SYSTEM. RESTART OF THE FANS SHALL BE INDEPENDENT OF THE FIRE ALARM RESET.
12. ALL MANUAL PULL STATIONS IN PUBLIC AREAS WILL HAVE PRE ALARM PROTECTIVE PLASTIC COVERS WITH BUILT IN SOUNDERS.

## LEGEND:

| DEVICE SYMBOL | SYMBOL DISCRIPTION | QUANTITY | MANUFACTURER |
|---|---|---|---|
| S | ADDRESSABLE PHOTO ELECTRIC SMOKE - CEILING MOUNTED | 84 | HONEYWELL |
| F/S | FAN SHUT DOWN AND RESTART RELAY (INDEPENDENT RESTART) | 3 | HONEYWELL |
| RA | FIRE-LITE ALARMS ANN-80 REMOTE ANNUCIATOR | 1 | HONEYWELL |
| P | ADDRESSABLE MANUAL PULL STATION | 3 | HONEYWELL |
| | STROBE ONLY | 17 | HONEYWELL |
| H | HORNSTROBE | 18 | HONEYWELL |
| H W | OUTDOOR HORNSTROBE - WEATHERPROOF | 2 | HONEYWELL |
| | F.A.C.P. - ADDRESSABLE FIRE ALARM CONTROL PANEL - FIRE-LITE ALARMS MS-9120UDLS - FLOOR TO BE MARKED 3' IN ALL DIRECTIONS FROM FIRE ALARM PANEL IN CONTRASTING COLORS AND LABELED "NO STORAGE" | 1 | HONEYWELL |

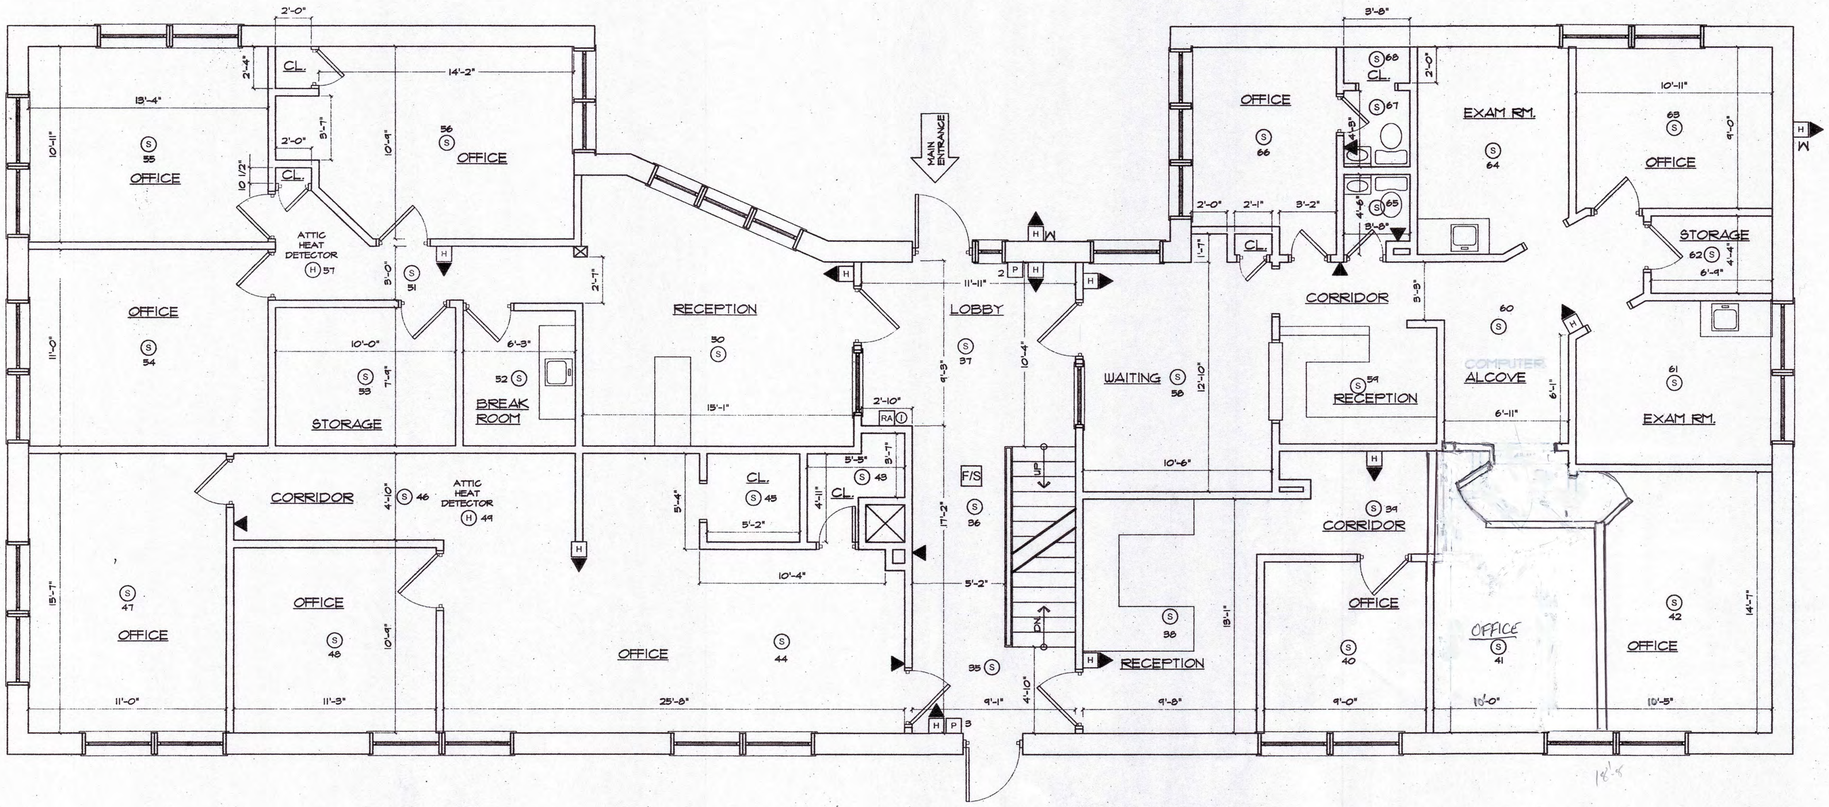


FIRST FLOOR FIRE ALARM PLAN
SCALE: 1/4"=1'-0"

PREPARED FOR:
PORT SECURITY AND COMMUNICATIONS
111 NORTH COUNTRY ROAD
PORT JEFFERSON, NY 11777
TEL 631-928-4458
NYS LIC.# 12000044029
CONTACT: MARC CLAS


CGA
Cataldo Grasso Architects, PC
14 Karl Avenue, Smithtown, NY 11787
Phone: (631) 724-2141
Fax: (631) 724-0407
Email: scarch@optonline.net


REVISION:
04.15.10 FOR APPROVAL
06.09.10 PER FIRE MARSHAL COMMENTS
10.13.10 ADDED DEVICE NUMBERS

FIRE ALARM PLANS
OFFICE BUILDING
354 VETERANS MEMORIAL HIGHWAY
COMMACK, NY 11725
TOWN OF SMITHTOWN
SCTM # 0800-122-1-14.3

| | |
|---|---|
| FIRST FLOOR FIRE ALARM PLAN | |
| PROJECT NO: | 10002 |
| DRAWN BY: | CG |
| DATE: | 04.15.10 |
| SCALE: | AS NOTED |

SHEET
FA-2
2 OF 3


COPYRIGHT 2010
Cataldo Grasso Architects, PC