RDM

DISCLAIMER:
THESE DRAWINGS WERE CREATED FOR **EAP AND/ OR FIRE SAFETY** FILING ONLY. DRAWINGS ARE **NOT TO SCALE** & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

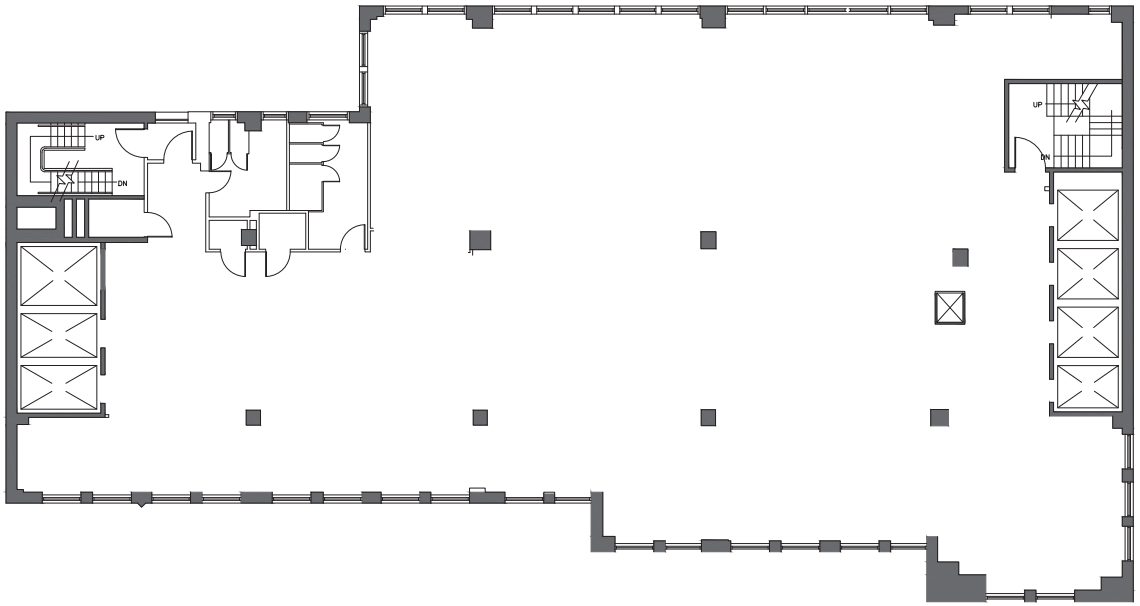

WEST 30TH STREET

LEGEND

- MANUAL PULL STATION
- STANDPIPE HOSE OUTLET
- FIRE WARDEN STATION
- FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE:	NAME:	ISSUED/ COMMENTS:
1	10.01.20	MB	REVISED PER SURVEY 09.15.20 ISSUED FOR REVIEW AND FILING
2	10.08.20	JW	REVISED PER COMMENTS ISSUED FOR REVIEW.

DRAWN BY/DATE:	CHECKED BY/DATE:
KM	DL

BUILDING ADDRESS:
150 WEST 30TH ST
NEW YORK, NY 10001

DRAWING TITLE:

SURVEY BY:	SURVEY DATE(S):
AR	09.15.20